

Millbrook Fire Department June 2018

Automatic Fire Alarm	14
Motor Vehicle Accident	5
Wire Down	1
EMS Call	45
Good Intent	1
Hazardous Material	1
<u>Carbon Monoxide Detector</u>	<u>2</u>
Total Incidents	69
EMS Responses	
NDP	29
MFD Rescue	18
ALS/Mutual Aid	14



V.M.P.D. Monthly Report June 2018

34 Calls for Service (including, but not limited to):

TRAFFIC

Traffic Tickets: 7 Parking Tickets: 3 Auto Accidents Property Damage: 2

ASSIST OTHER AGENCIES

Assist Other Police: 2 Assist Fire Dept: 3 Assist EMS: Village: 4; Town of Washington: 2

CRIMINAL ACTIVITY

Suspicious Activity: 2 Burglar Alarms: 4 Illegal Dumping: 1

PUBLIC SERVICE

Assist Citizen: 2 Animal Complaint: 2

(School Checks: 12)

JRW#6

07/10/2018

- 1 Removed , framed and poured 61 feet of sidewalk on Friendly lane
- 2 Repaired carbon monoxide detector at Village hall
- 3 Continued weed killing
- 4 Trimmed trees on Haight ave.
- 5 Cut back trees and bushes in front of welcome to Millbrook and Millbrook business signs
- 6 Swept up storm washout debris on several streets
- 7 Removed down tree on Alden ct due to high winds.
- 8 Vacuumed catch basins
- 9 Tree trimming on Maple ave and Hearts village
- 10 Worked with VRI at water plant installing pipe for drainage and removing dabriss
- 11 Repaired manhole on Valley farm rd
- 12 Cold patch several spots on Russell Knowles
- 13 Rebuilt catch basin on at Thorne Building



Village of Millbrook
 Monthly Water System Report
July 2018


	June	May	April
Total Water Produced	8,490,000	8,115,000	7,625,000
Average Daily Flow	283,000	262,000	226,000
Peak Day Flow	390,000	310,000	300,000
Sampling Results:			
Total Coliform	Absent	Absent	Absent

* Results not in compliance

Comments:

- 1) Monthly sampling and maintenance
- 2) Repaired water leak behind Town Highway
- 3) Repaired fire hydrant on Franklin Ave in front of Deli
- 4) Replaced fire hydrant at intersection of North and Fountain
- 5) Read water meters

Millbrook Water

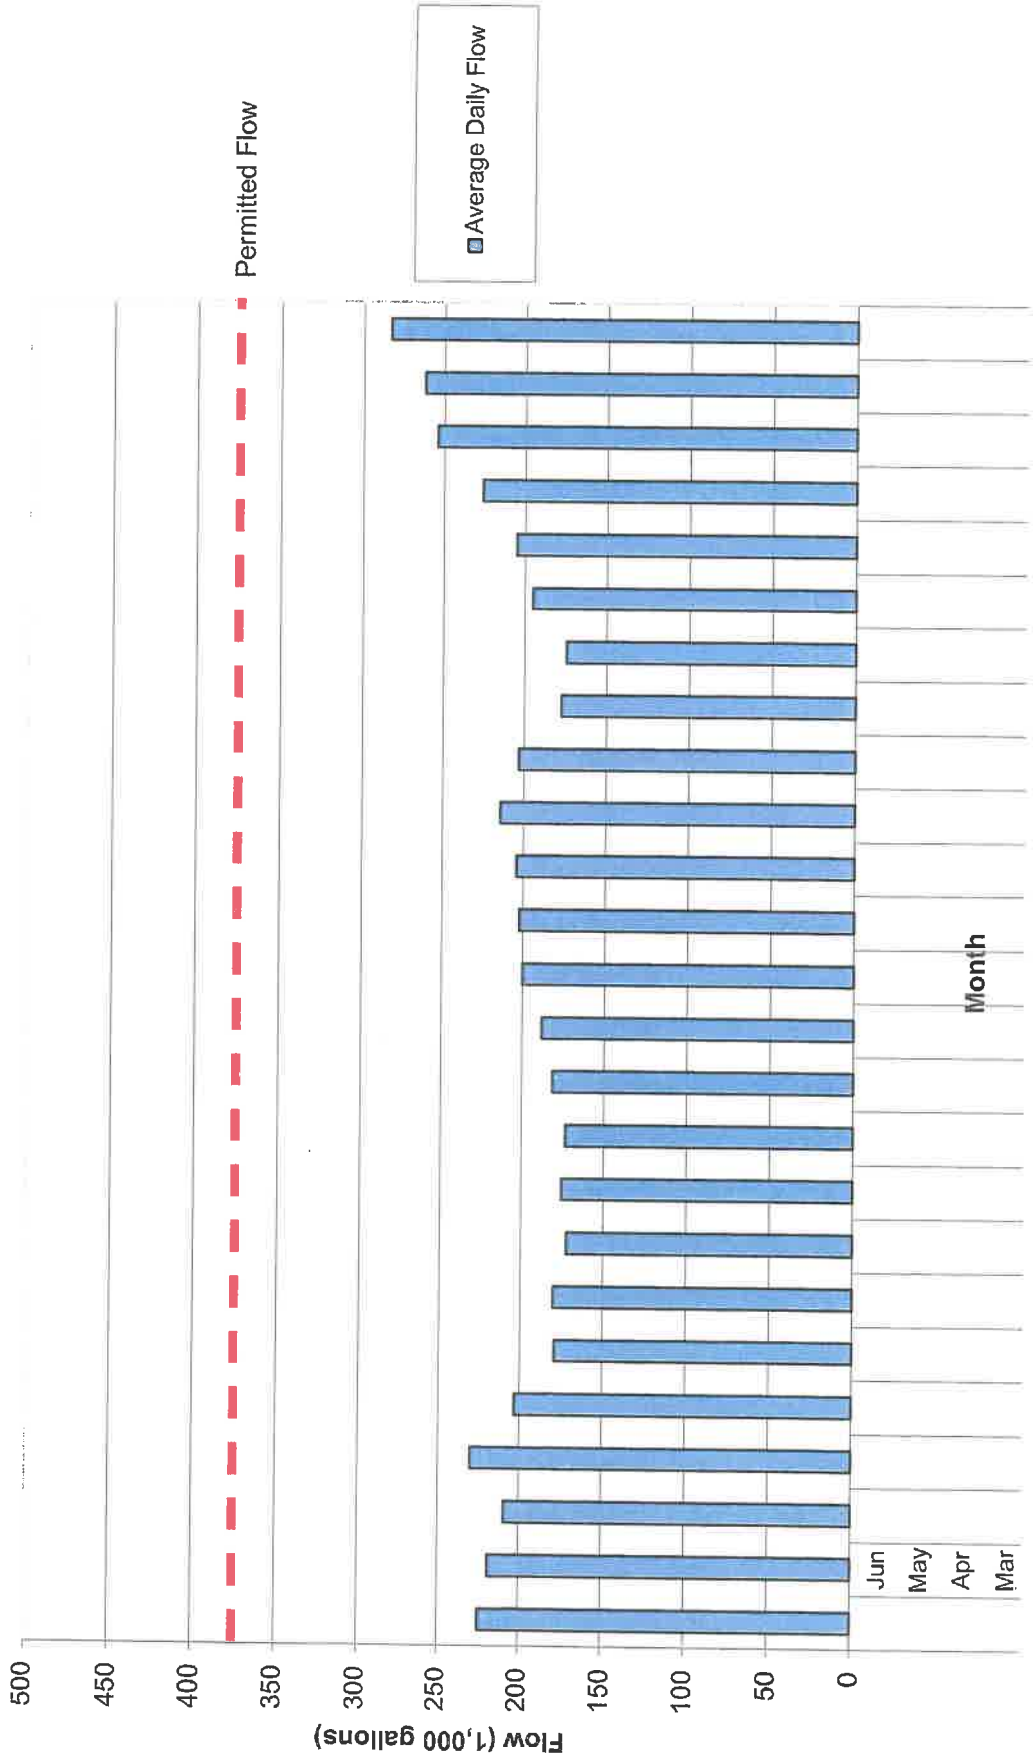

Village of Millbrook
Wastewater Treatment Plant Operations Report
July 2018

	June	May	April	Permit Limit
Total Effluent Flow	4,347,628	5,491,849	6,344,289	N/A
Average Daily Flow	144,900	177,200	211,500	N/A
12-Month Rolling AVG	172,000	173,000	173,000	250,000
Peak Daily Flow	178,867	317,340	271,392	N/A
Precipitation (inches as liquid)	3.90	2.9	4.8	N/A
SPDES Permit Samples: (mg/l)				
BOD	4 mg/l	3 mg/l	4 mg/l	15 mg/l
Percent Removal	98.0 %	99 %	98 %	85 %
Total Suspended Solids	1 mg/l	1 mg/l	2 mg/l	15 mg/l
Percent Removal	100.0 %	100 %	98 %	85 %
TKN as N	0.6 mg/l	2.4 mg/l	2.5 mg/l	8 mg/l
Fecal Coliform	2 / 100ml	48 / 100ml	N/A	200 /100ml

* Exceeds permit limit

Comments:

- 1) Performed all monthly sampling and maintenance
- 2) EarthCare and Royal hauled sludge
- 3) Repaired pump base at Bennett PS
- 4) Generator Serviced - need fan belt (see quote)

